



Multifarious Technique Applied for the Correctness the Nervous System of Electricity Demand Using GA & AI Technique

Ashish Dhamanda

Electrical Engineering Department

Faculty of Engineering & Technology

Gurukula Kangri (Deemed to be University) Haridwar, UK, India

ABSTRACT

Due to huge electricity demand by consumers in all over the world being a volumetric challenge to engineer, researcher, scientist, and academician. As Nerve cells generate electrical signals and neurons control and communicate with our brain and bodies by transmitting information in a form of electricity, although neurons are not intrinsically good conductors of electricity. For fulfilling the electricity demand, it become necessary to continue enhance and improve the nervous system of the generating system by searching and applying the new techniques. In this paper, multifarious technique applied for the correctness the nervous system of electricity demand. Multifarious technique like; Traditional (PI, PID), Artificial Intelligent (Fuzzy) and GA Technique has been applied for effective outcome of amphibolic system, when the system is operating normal condition and also when in disturbing condition. Thermal unit has been considered as a source of electrical power generation. The comparative results shows that the GA technique gives better and effective results with respect to the other techniques by correctness the nervous system of the generating unit with expeditiously rising electricity demand.

Keywords: Nervous System, Amphibolic System, Traditional Technique, Artificial Intelligent Technique, GA Technique, Power Generation, Thermal Source, Electricity Demand.

DOI Number: 10.14704/nq.2022.20.5.NQ22657

NeuroQuantology 2022; 20(5):3592-3598

3592

1. INTRODUCTION


Increasing the demand of electricity is one of the worst and biggest crises in the universe. More than half of the world's electric energy demand meets by thermal power generating plants. Through burning some fossil fuel in these power stations, steam is produced, which is then used to operate the steam turbines. Therefore, thermal power plants may also be classified as steam power plants. The steam is then condensed in the steam turbine, and then condensed in the condenser, and then the steam is reheated in the steam turbine. This is the ranking phase. The thermal power plant is a power plant that generates energy by burning fossil fuels, including coal, petroleum, etc. It conducts the chemical energy from the gasoline into mechanical energy and then translates it into electrical energy.

This power is transferred to a motor which drives a generator which generates electricity. Thermal power plants are planned for continuous operation, which enables the plant to run for years. The unit used to transform thermal energy into mechanical energy is known as a turbine. In thermal power plants, the fuel is used to convert heat to water. This hot water is converted to steam, and then the pressure is required for turbines to work. To produce mechanical energy, either the steam turbine or the gas turbine can be used. For controlling the frequency and power in the limit some computational technique like; traditional (PI, PID), artificial intelligent (Fuzzy) and GA technique has been applied. The nervous system is a complicated combination of nerves and cells known as neurons that transmit signals between different



parts of the body. It is essentially the body's electrical wiring. Although neurons are not intrinsically good conductors of electricity, they have evolved elaborate mechanisms for generating

electrical signals based on the flow of ions across their plasma membranes. [1], [2], [5], [10], [20], [21], [24], [25], [26], [28], [29], [30], [31], [32], [33].

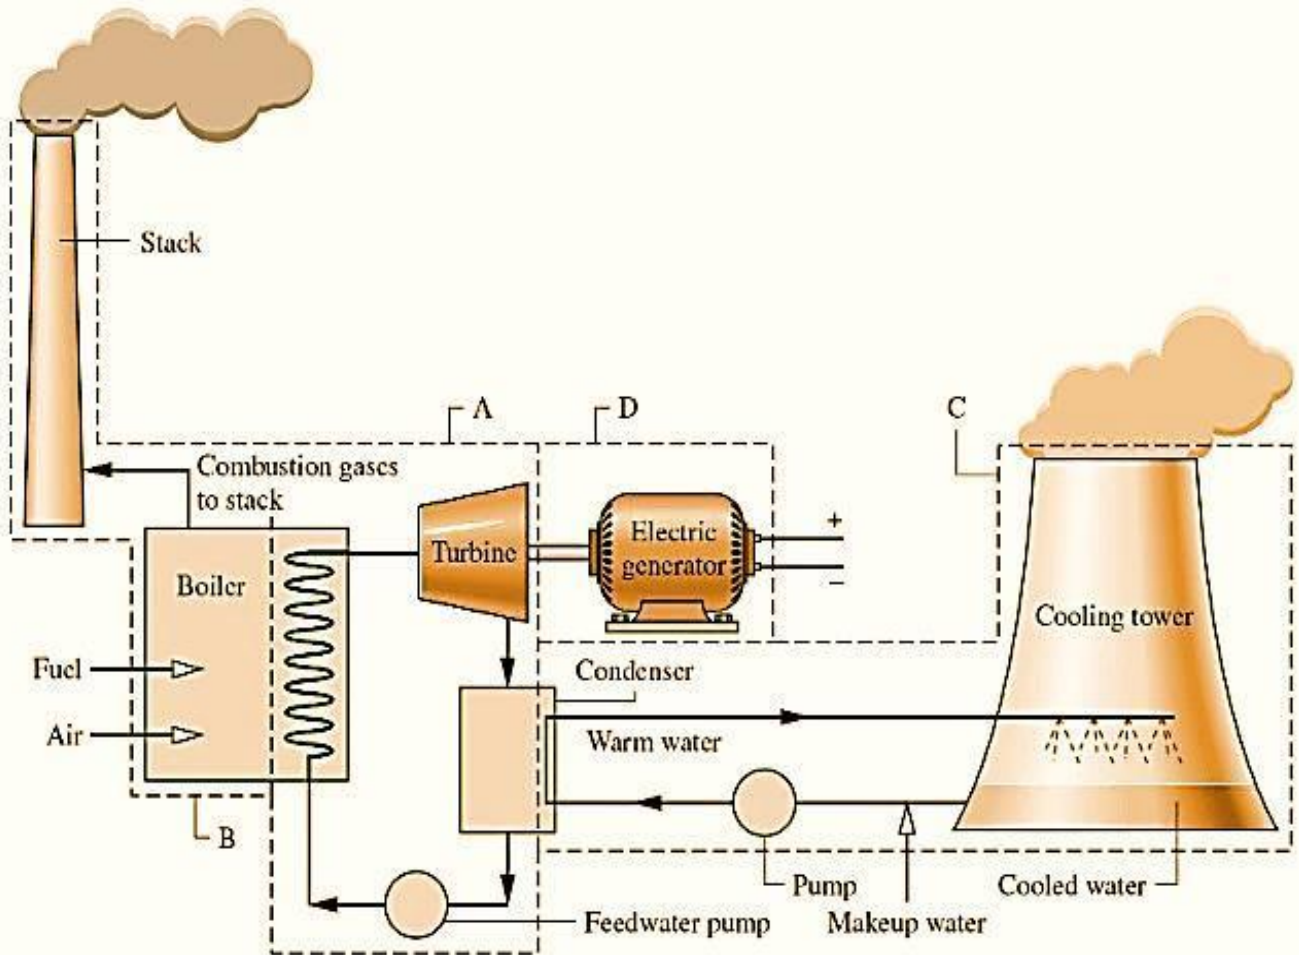

3593

Figure 1 Typical Layout of a Thermal Power Plant

2. EQUATION FOR SYSTEM

The mathematical model can be developed which is based on small deviations around a nominal steady state. Let us assume that under steady state power delivered (P_g) from the generator at nominal speed or frequency (F). Under this condition, the equation of frequency and power has been obtained and shown below;

2.1 Equation of Frequency

Let us consider a simple case wherein the speed changer has a fixed setting, which means $\Delta P_c = 0$ and the load demand alone changes.

For a sudden step change of load demand (ΔP_d),

$$\Delta P_g(s) = \frac{\Delta P_d}{s} \quad (1)$$

the change in frequency is given by

$$\Delta F(s) |_{\Delta P_c(s)=0} = -\frac{K_{ps} \cdot \Delta P_d \cdot RT_{ps}}{T_{ps} \cdot K_{ps+R}} \left[\frac{1}{s} - \frac{1}{(s + \frac{K_{ps+R}}{RT_{ps}})} \right] \quad (2)$$

$$\Delta f(t) = L^{-1} \Delta F(s)$$

$$\Delta f(t) = \frac{RK_{ps}}{K_{ps+R}} \left[1 - e^{-\frac{t}{RT_{ps}K_{ps+R}}} \right] \Delta P_d \quad (3)$$

2.2 Equation of Corresponding Power



Corresponding Power must be accounted for the incremental power balance equation of each area, since there is power flow in or out of the area through the tie line.

Power flow out can be expressed as

$$\Delta P_{TL1}(s) = 2\pi T_{12} \left[\frac{\Delta F_1(s)}{s} - \frac{\Delta F_2(s)}{s} \right] \quad (4)$$

T_{12} is known as the synchronizing or the stiffness coefficient of the tie-line. [2], [3], [4], [5], [8], [10], [14], [16], [17], [18], [19], [32], [33].

3. MULTIFARIOUS TECHNIQUES

In this paper traditional (PI, PID), artificial intelligent (Fuzzy) and GA technique has been used to control the correctness and limit of frequency and power variation.

3.1 Traditional Technique (PI And PID)

Different types of technique are using from past year for controlling the frequency and power flow in interconnected power system. PI (Proportional Plus Integral) and PID (Proportional Plus Integral Plus Derivative) techniques are the traditional technique shown in figure 2.

The transfer function of the PI controller is

$$G(s) = K_p + \frac{K_i}{s} \quad (5)$$

Where K_p is proportional gain and K_i is an integral gain.

The transfer function of the PID controller is

$$G(s) = K_p + \frac{K_i}{s} + sK_d \quad (6)$$

Where K_p is proportional gain, K_i is an integral gain and K_d is derivative gain.

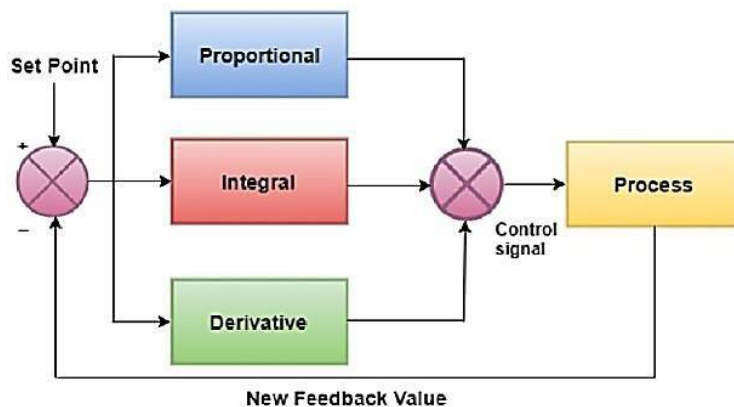


Figure 2 Traditional Technique for Correctness the Nervous System

3.2 Artificial Intelligent Technique (Fuzzy)

Fuzzy controllers, formulated on the basis of human understanding of the process or identified from measured control actions, can be regarded as emulators of human operators. Fuzzy logic control has more advantages because it can compensate the bad influence by nonlinearity and uncertainties based on advanced human expertise experience, also because it has strong robustness independent of a mathematical model. Fuzzy logic controller is shown below in figure 3.

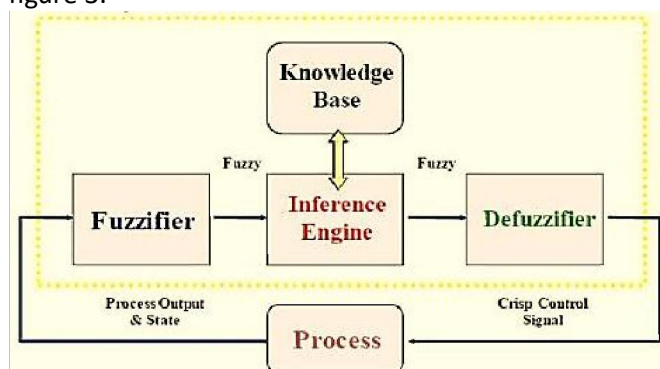


Figure 3 AI Technique for Correctness the Nervous System

3.3 GA Technique

Genetic Algorithm (GA) is the collective name for a range of problem-solving techniques based on principles of biological evolution, which are being increasingly applied to a variety of problems, ranging from practical applications in industry and commerce to leading-edge scientific research. The parameter used in GA controller for solving the problem of frequency and power in thermal generating unit is shown in Table 1. All the parameters value has been chosen default.

Table 1: GA Parameters for System

Parameters	Fitness Function	Variables	Population Size	Selection	Mutation	Cross Over	Bound Limit
Generating System	@pama_ash	6	29	Stochastic Uniform	Constraint Dependent	Scattered	Upper [0] and Lower [-5]

It uses iterative progress, such as growth or development in a population. This population is then selected in a guided random search using parallel processing to achieve the desired end. Such processes are often inspired by biological mechanisms of evolution. Main parts of GA are chromosomes, selection, recombination (crossover), mutation. Flow Chart shown in figure 4;

3595

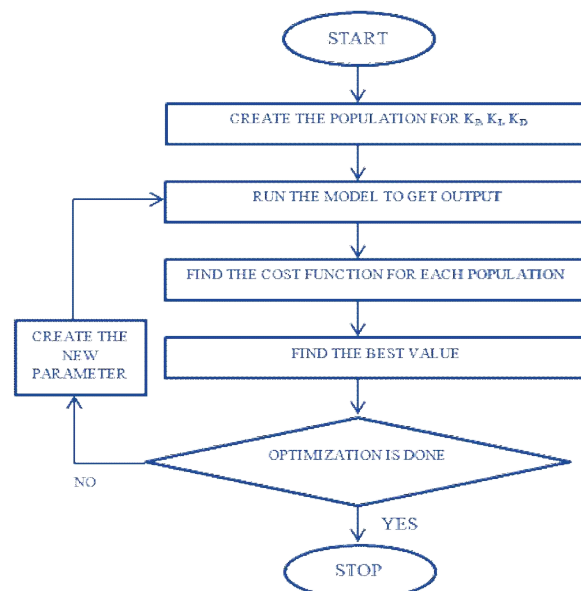


Figure 4 Flow chart of GA

4.RESULTS AND DISCUSSION

Tin this paper different techniques (Traditional, Artificial intelligent technique and GA) has been used for the correctness of the nervous system of electricity demand in the term of frequency and power variation. The results of figure 5 and figure 6 has been tabulated in Table 2,



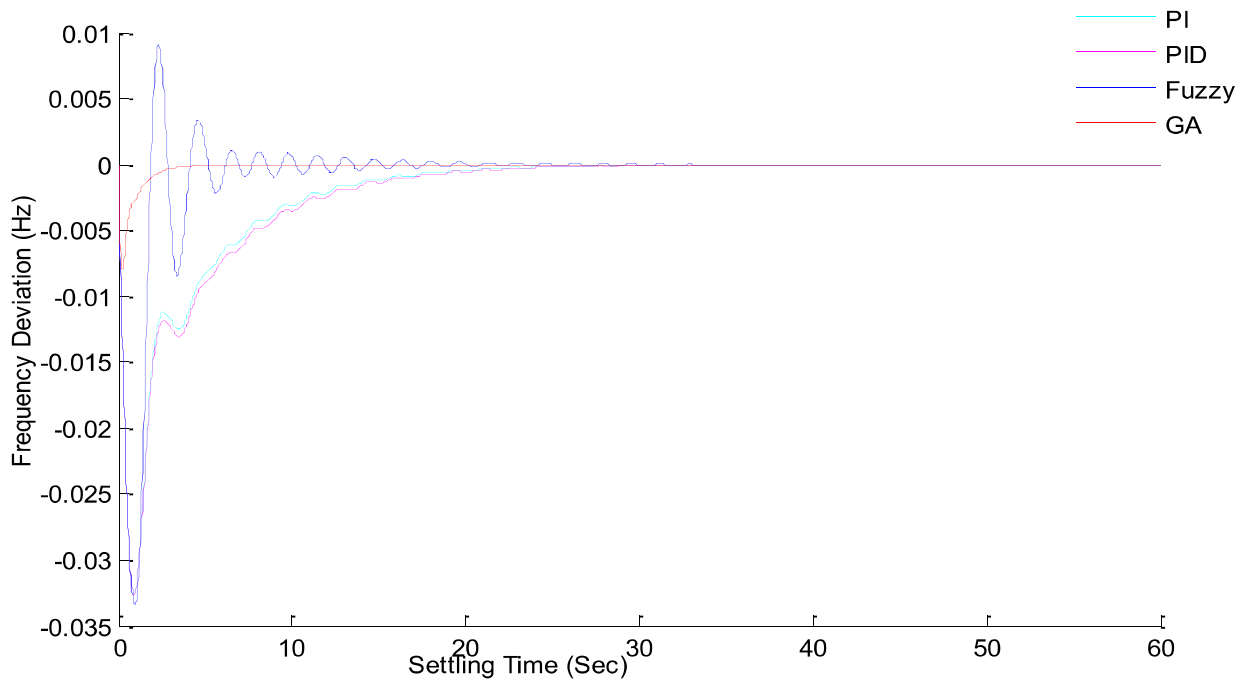


Figure 5 Frequency Correctness Response of Nervous System of Thermal Plant

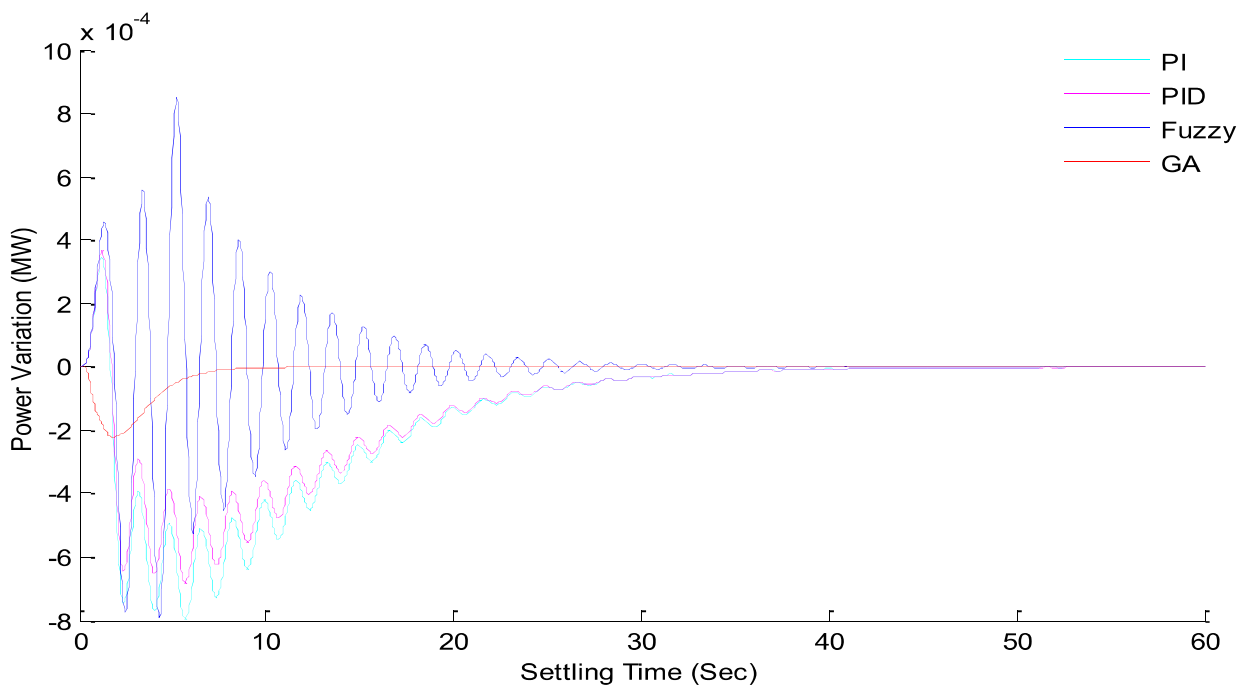


Figure 6 Power Correctness Response of Nervous System of Thermal Plant

Comparative results obtained from different techniques have been tabulated in Table 2.

Table 2: Comparative Result of All Techniques

Technique	Frequency Deviation Settling Time (Sec)	Power Deviation Settling Time (Sec)
Traditional(PI)	26	39
Traditional (PID)	25	38
Artificial Intelligent(Fuzzy)	23	28



GA	5	8
----	---	---

Table 2 shows that GA technique gives improved and efficient result compare to traditional (PI, PID) and artificial intelligent (Fuzzy) technique for correctness of the nervous system of electricity demand.

5. CONCLUSION

For making the limitness and correctness the nervous system of electricity demand, multifarious technique like; Traditional (PI, PID), Artificial Intelligent (Fuzzy) and GA Technique has been applied for effective outcome of amphibolic system, when the system is operating normal and disturbing condition. Thermal unit has been considered as a source of electrical power generation. The comparative results tabulated in table 2 shows that the GA technique, settle down the disturbance in 5 Sec and 8 Sec for frequency and power variation with compare to other technique. It can be concluded that the GA techniques gives better and effective results with respect to the other techniques by correctness the nervous system of the generating unit with expeditiously rising electricity demand.

REFERENCES

- 1) Van Van Huynh, Phong Thanh Tran, Tien Minh Nguyen, Van-Duc Phan, and Viet-Thanh Pham, *Advanced Sliding Mode Observer Design for Load Frequency Control of Multiarea Multisource Power Systems*, International Transactions on Electrical Energy Systems, Volume 2022, <https://doi.org/10.1155/2022/6587194>.
- 2) Ashish Dhamanda, *Computational Techniques for the issue of Variation Problem*, International Journal of Control Systems and Robotics, Volume 7, 2022, ISSN: 2367-8917.
- 3) Ashish Dhamanda, Different computational technique for solution of variation issue, Open Access Research Journal of Engineering and Technology, 01(01), 039–046, ISSN 2783-0128, DOI: 10.53022/oarjet.2021.1.1.0118. 2021.
- 4) Ashish Dhamanda, *Artificial Intelligence for Power and Frequency Variation Control*, Book Artificial Intelligence Applications, ISBN: 978-625-8423-28-0, Iksad Publications 2021.
- 5) Ashish Dhamanda and A. K. Bhardwaj, *Problem of Thermal Generating Unit Solve Through Different Controller*, WSEAS TRANSACTIONS ON HEAT and MASS TRANSFER DOI: 10.37394/232012.2020.15.4, E-ISSN: 2224-3461, Volume 15, 3 March 2020.
- 6) Ashish Dhamanda, *GA Technique to Solve the AGC Problem of Thermal Generating Unit*, WSEAS TRANSACTIONS ON HEAT and MASS TRANSFER DOI: 10.37394/232012.2020.15.2, E-ISSN: 2224-3461, Volume 15, 27 February 2020.
- 7) Han, D., Tong, XJ. *Review of Mathematical Methodology for Electric Power Optimization Problems*, Journal of the Operations Research Society of China volume 8, 295–309, 2020. <https://doi.org/10.1007>.
- 8) Ashish Dhamanda, Gajendra Singh Rawat, *GA Technique to Solve the Load Frequency and Tie-Line Power Problem of Thermal Generating Unit*, Advances in Networks, DOI: 10.11648/j.net.20190702.16, ISSN: 2326-9766 (Print); ISSN: 2326-9782 (Online), 7(2): 51-58, 2019.
- 9) Ashish Dhamanda and AK Bhardwaj, *Multi Area AGC Problem of T.G.U Solved Through GA (Using Tuning of PID) Controller*. International Journal of Advancements in Technology DOI: 10.4172/0976-4860.1000207, Volume 9, Issue 3, ISSN: 0976-4860, June 2018.
- 10) B. O. Ogbonna, S. N. Ndubuisi and S. Orike, *Design of Fuzzy Logic Load Intelligent Frequency Controller for Interconnected Power System Network*, CiiT International Journal of Fuzzy Systems, Vol 10, No 10, 0974-9721/CIIIT-IJ-7684/07/\$20/\$100 © 2018 CiiT, 2018.
- 11) Ashish Dhamanda, AruneshDutt, A.K.Bhardwaj, *Automatic Generation Control of Thermal Generating Unit using Evolutionary Controller*. International Journal of Advanced Intelligence Paradigms (IJAIP), DOI: 10.1504/IJAIP.2017.10009224, ISSN: 1755-0394 Vol. 9, No. 5/6, Page 490-504, 2017.
- 12) Ashish Dhamanda, G.S.Rawat, AruneshDutt, *AGC in Five Area Interconnected Power System of Thermal Generating Unit Through Fuzzy Controller*, American Journal of Energy and Power Engineering (AJEPE), Vol.4 No.6, Page 44-58, ISSN: 2375-3897, 2017.
- 13) Ashish Dhamanda, A.K.Bhardwaj, *AGC in Four Area Interconnected Power System of Thermal Generating Unit through Evolutionary Technique*. Research Journal of Applied Science,



- Engineering and Technology, 13(2): 113-121, 2016 DOI:10.19026 /rjaset.13.2922 ISSN: 2040-7459, Maxwell Science Publication July 15, 2016.
- 14) Ashish Dhamanda, AruneshDutt, A.K.Bhardwaj, *Automatic Generation Control in Four Area Interconnected Power System of Thermal Generating Unit through Evolutionary Technique*. International Journal on Electrical Engineering and Informatics (IJEEI), Volume7, Number 4, DOI: 10.15676/ijeei. 2015.7.4.3. ISSN: 2087-5886 December 2015.
 - 15) Ashish Dhamanda, A.K.Bhardwaj, *Automatic Generation Control in Three Area Interconnected Power System of Thermal Generating Unit Using Evolutionary Controller*. International Journal of Scientific & Engineering Research (IJSER), ISSN 2229-5518, Vol 6, Iss. 6, June 2015.
 - 16) Naresh Kumari, A. N. Jha, *Automatic Generation Control Using LQR based PI Controller for Multi Area interconnected Power System*, Advance in Electronic and Electric Engineering, ISSN 2231-1297, Volume 4, pp. 149-154, 2014.
 - 17) Ashish Dhamanda, A.K.Bhardwaj, *Automatic Generation Control of Thermal Generating Unit by using Controller and Intelligent Controller*. International Journal of Electrical Engineering & Technology (IJEET), ISSN 0976–6553, Vol. 5, Issue. 10, October 2014.
 - 18) Ashish Dhamanda, A.K.Bhardwaj, *Automatic Generation Control of Reheat Thermal Generating Unit through Conventional and Intelligent Technique*. International Journal of Advanced Research in Engineering & Technology (IJARET), ISSN 0976–6499, Vol. 5, Issue 11, Nov 2014.
 - 19) Ashish Dhamanda, AruneshDutt, Surya Prakash, A.K.Bhardwaj, *A Traditional Approach to Solve Economic Load Dispatch Problem of Thermal Generating Units using MATLAB Programming*, International Journal of Engineering Research & Technology (IJERT), ISSN: 2278-0181, Vol. 2, Issue 9, September 2013.
 - 20) Rishabh Verma, Shalini Pal, Sathans, *Intelligent Automatic Generation Control of Two-Area Hydrothermal Power System using ANN and Fuzzy Logic*, IEEE 978-0-7695-4958-3/13, 2013.
 - 21) Surya Prakash, S K Sinha, *Four Area Load Frequency Control of Interconnected Hydro-Thermal Power System by Intelligent PID Control Controller*, IEEE 978-1-4673-0455-9/12, 2012.
 - 22) Sapna Bhati, DhiirajNitnawwre, *Genetic Optimization Tuning of an Automatic Voltage Regulator System*, IJSET, Volume No.1, Issue No. 3, ISSN: 2277-1581, pg: 120-124, 2012.
 - 23) Gabano J.D., Poinot T. and Kanoun H., *Identification of a Thermal System Using Continuous Linear Parameter Varying Fractional Modelling*, IET Control Theory Application, Vol. 5, issue 7, p. 889-899, 2011, DOI: 10.1049/iet-cta.2010.0222.
 - 24) K. P. Singh Parmar, S. Majhi, D. P. Kothari, *Optimal Load Frequency Control of an Interconnected Power System*, MIT IJEE Vol. 1, No. 1, ISSS No. 2230-7656, pp. 1-5, 2011.
 - 25) Xiangjie Liu, Xiaolei Zhan, Dianwei Quian, *Load Frequency Control considering Generation Rate Constraints*, IEEE 978-1-4244-6712-9/10, 2010.
 - 26) Kiran Kumar Challa, P. S. Nagendra Rao, *Analysis and Design of Controller for Two Area Thermal-Hydro-Gas AGC System*, IEEE978-1-4244-7781-4/10, 2010.
 - 27) Ranjit Roy, S. P. Ghoshal, Praghnessh Bhatt, *Evolutionary Computation based Four-Area Automatic Generation Control in Restructured Environment*, IEEE978-1-4244-4331-4/09, 2009.
 - 28) Park Min-Su and Chun Yeong-Han, *Tuning of Generating Unit Controller for the Generators with Governor*, Transmission & Distribution Conference & Exposition: Asia and Pacific, pp.1-4, 2009 DOI: 10.1109/TD-ASIA.2009.5356854.
 - 29) Magla, J. Nanda, *Automatic Generation Control of an Interconnected Hydro-Thermal System Using Conventional Integral and Fuzzy logic Control*, in Proc. IEEE Electric Utility Deregulation, Restructuring and Power Technologies, 2004.
 - 30) K. F. Man, K. S. Tang and S. Kwong, *Genetic algorithm: Concepts and applications*, IEEE Trans. Ind. Electron, vol. 43, no. 5, pp. 519-534, 1996.
 - 31) Elgerd O. I, *Electric Energy System Theory; an Introduction*, McGraw Hill, 1971.
 - 32) D. P. Kothari, Nagrath, *Modern Power System Analysis*, Tata McGraw Hill, Third Edition, 2003.
 - 33) S. Sivanagaraju, G. Sreenivasan, *Power System Operation and Control*, PEARSON, 2011.

